

ZS-DDW-NF

DIRECT DRINKING WATER EQUIPMENT

ZS-DDW-NF

PH

99.56

<







75%

99.56





PH
PH



1m/s





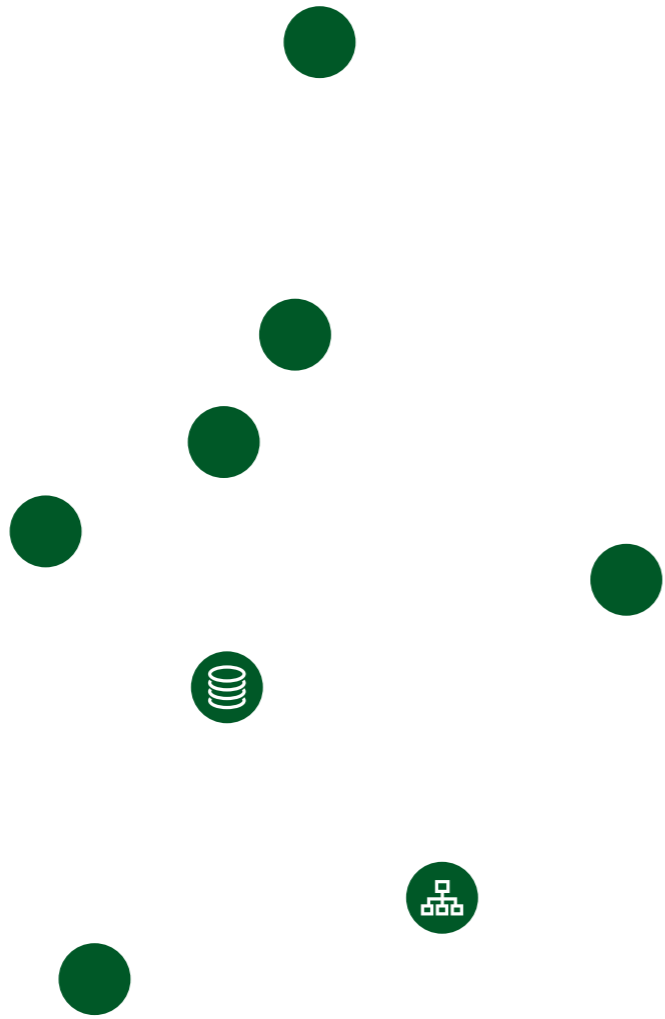



1991 2010 12 9 300145
100

2016

ISO 9001

