



# ZS-DDW-NF

DIRECT DRINKING WATER EQUIPMENT

ZS-DDW-NF

PH

99.56  
<







75%

99.56



PH  
PH




1m/s









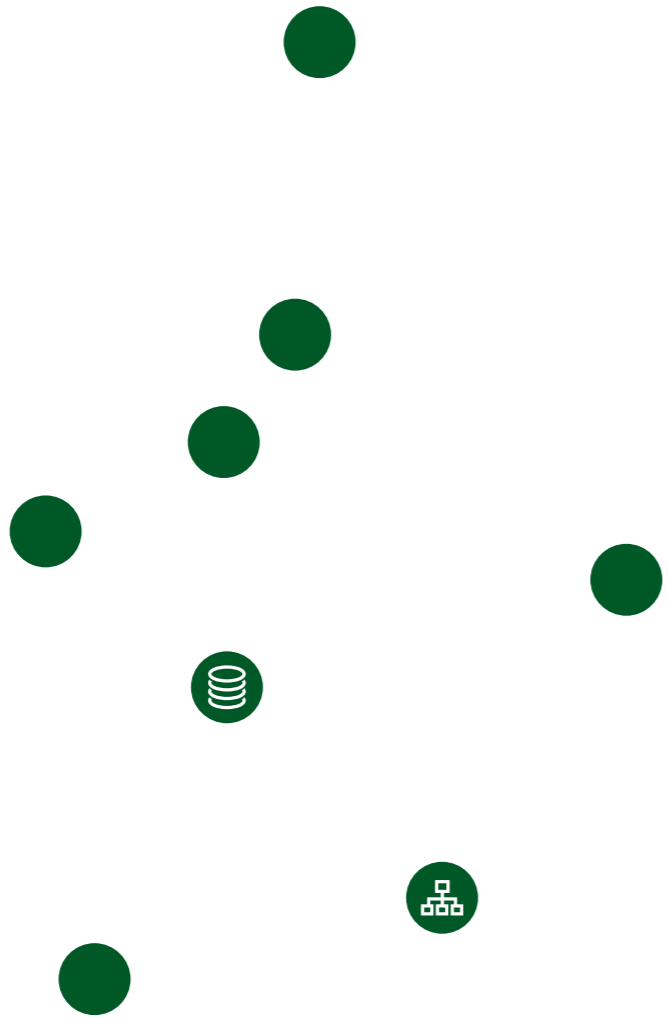





---

1991      2010 12 9      300145  
100

2016

---

ISO 9001

