

NFST

INTEGRATED SEWAGE TREATMENT EQUIPMENT

让用水更安心
To make it secure to water-using




...S...m...a...p...24...p... (** - u s S m a r p m € 0 à ' P ò l b c " O 0 b - 9 9 c l - 9 9 N C E - 9 - - 6 - 9 - x - 9 - - 9 9 N t - 9 9 % a - 9 9 f 6 - 9 9 Y 4 9 - P p c " m p ò c " m p > c " G o 9 q 6 ' - 3 U * E ' # p " a - - f x t - c a n N A O ... " N N A v t j y N A r e " - - 8 b + Q A n n f ' y 4 I I l - z N x ' N 3 % % a a - A D I r " " F e r . H P B " Y H G A F E ° w 7 U y G I ' A ... " C D - p z q r - p 8 - q ÷ y > q - s E S Ç B ' F " " 9 q 4 F " " 3 O E " i * c € y S v 3 g # ' x % B l ÷ A F h s * R P * R F " " % q) " " w R W R " " A I " " Q l ... 6 " R U R - u & y - y " " i g " " ,

E A A > I H I H G F F
<http://www.cnps.cn>

g - [Q I S a N f - b c ' g C y N [' , N a N G O U _ b _ [u k d . o f N i * U ' L Q h * e b * e R Y R 6 0
h z y , ' t t y v t , - f r e ' t S . z h v e r ' t y , . z r t z € , e , t f v . . z h v u t ,
r € E w . . , w i y z t f v t z m r z € r . v t , f a v u z E S y ,) v . . . z E f r . t .

Q I S a W _ U ' C u (u ' - , - S p R 7 0
T , - f r e E f . . w v s (E t z e x v t ,) , x z r) f r f v . . f . z e t z e x .



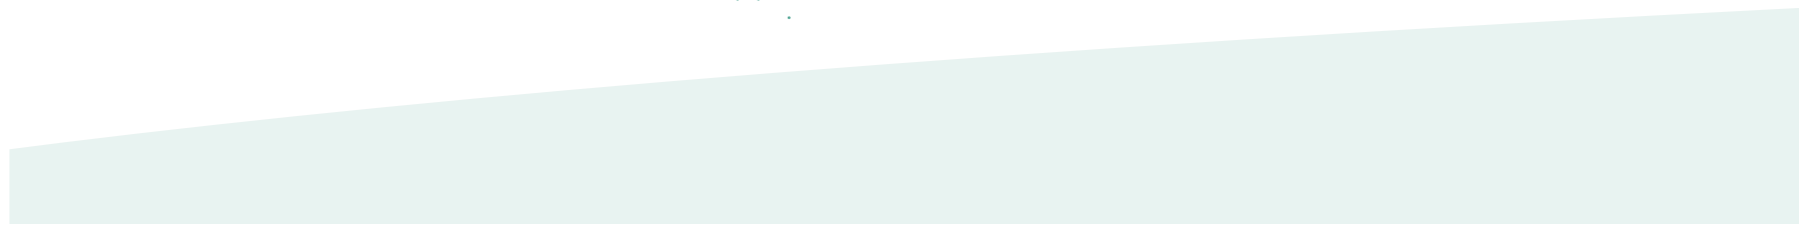

" "

NFST

" + " " "+" "

NFST


N P





E-

>

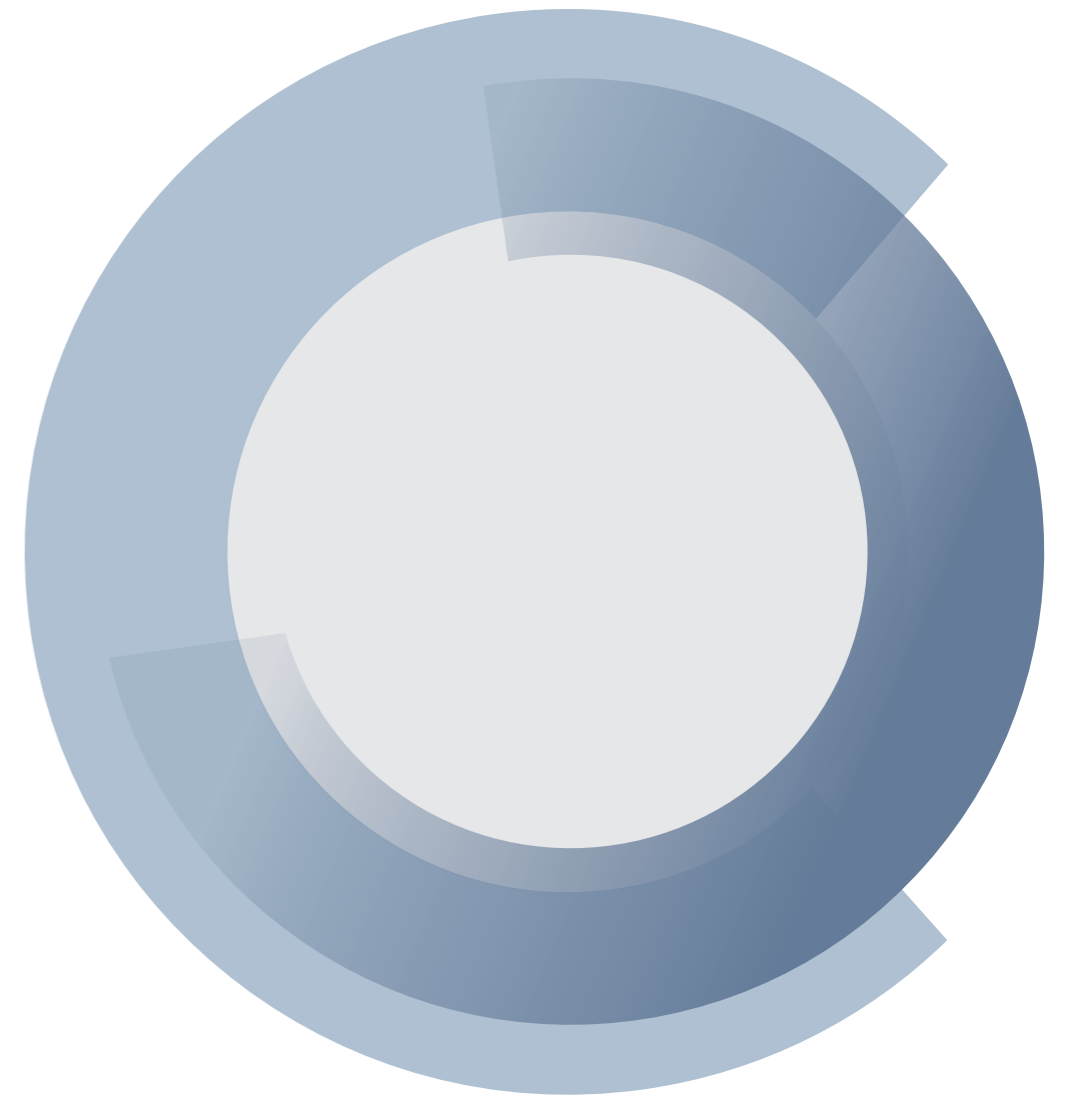

1991


2010 12 9

300145

100



ISO 9001




0-Uc14%Y-%e%U.T g Rj%#B0 %y/SUOM




N-Vy,ey=#A'ANI



N-Vys Xfh _xy ZW-y N\$T#=#A'ANI



*[i](t OSj#=#A'ANI



eLN Pe^%#Qh(i OSj#=#A'ANI



s^Xf(i OSj#=#A'ANI



O N O#u(=#A'ANI



-y^#Q_eyc^fPN\$T#=#A'ANI



T.T _#4(i g Rj#=#A'ANI



y>O^#N0(i OSj#=#A'ANI



N-VyW#GO#4c14SOO^#Rj(N#SUOM



-U#4c14'LN z^Q#s.O N



ryyl^XY u N\$; Si#A



[^#Qhu N\$# Q#ES N -SO N ^ANI



NSS #T(i OSj#=#A'ANI



T^hu(4Sku [%#QhN\$TASku ; SibyN#



O#^#Qh(i OSj#=#A'ANI



^i^%LN y#E# g#e#^#yyl^ANI



U.T SANCEI -Sj#=#A'ANI

